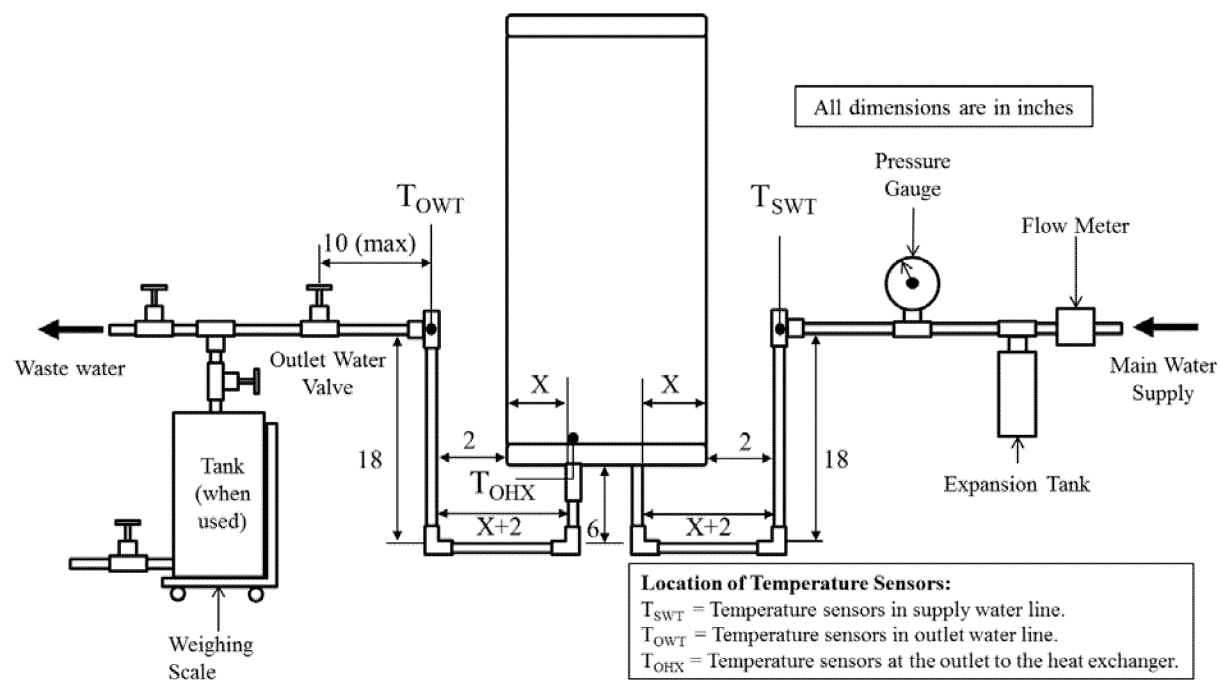


**Figure 2.1. Set-up for thermal efficiency and standby loss test for gas-fired and oil-fired instantaneous water heaters and hot water supply boilers (other than storage-type instantaneous water heaters) equipped with vertical (top) connections not requiring a recirculating loop.**



**Figure 2.2. Set-up for thermal efficiency and standby loss test for gas-fired and oil-fired instantaneous water heaters and hot water supply boilers (other than storage-type instantaneous water heaters) equipped with vertical (bottom) connections not requiring a recirculating loop.**